

**October
2000**

PUBLIC SERVICE COMMISSION OF WISCONSIN



Final Environmental Impact Statement

Arrowhead – Weston Electric

Transmission Line

Project – Volume 2

Docket 05-CE-113
Date Issued, October 2000

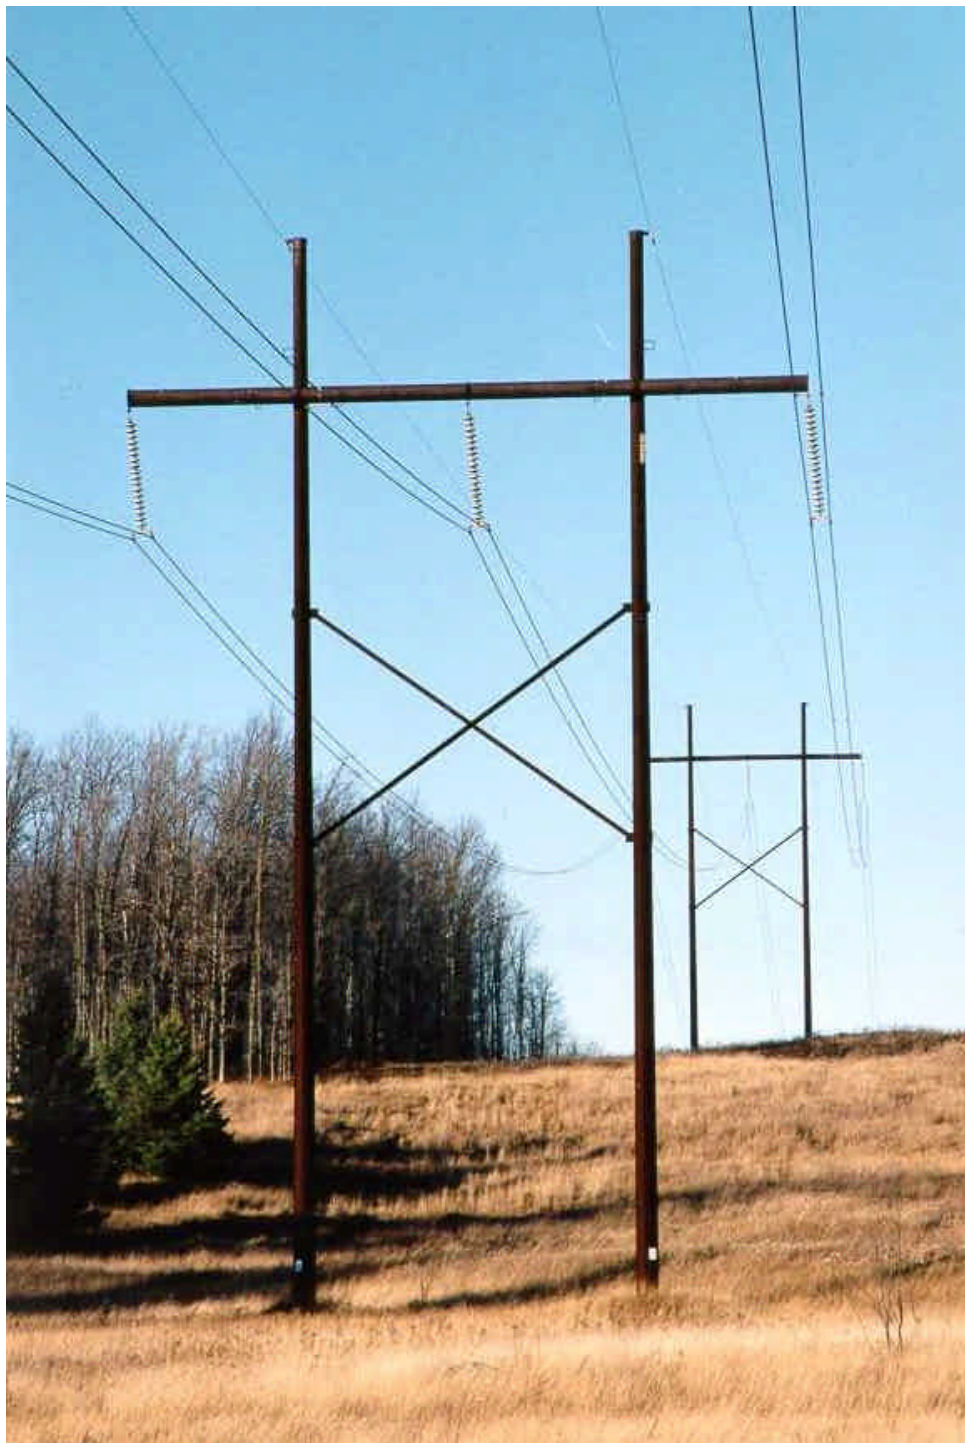


Figure Vol. 2-1 345 kV, Single Circuit, Bundled Conductor, H-Frame Steel Pole

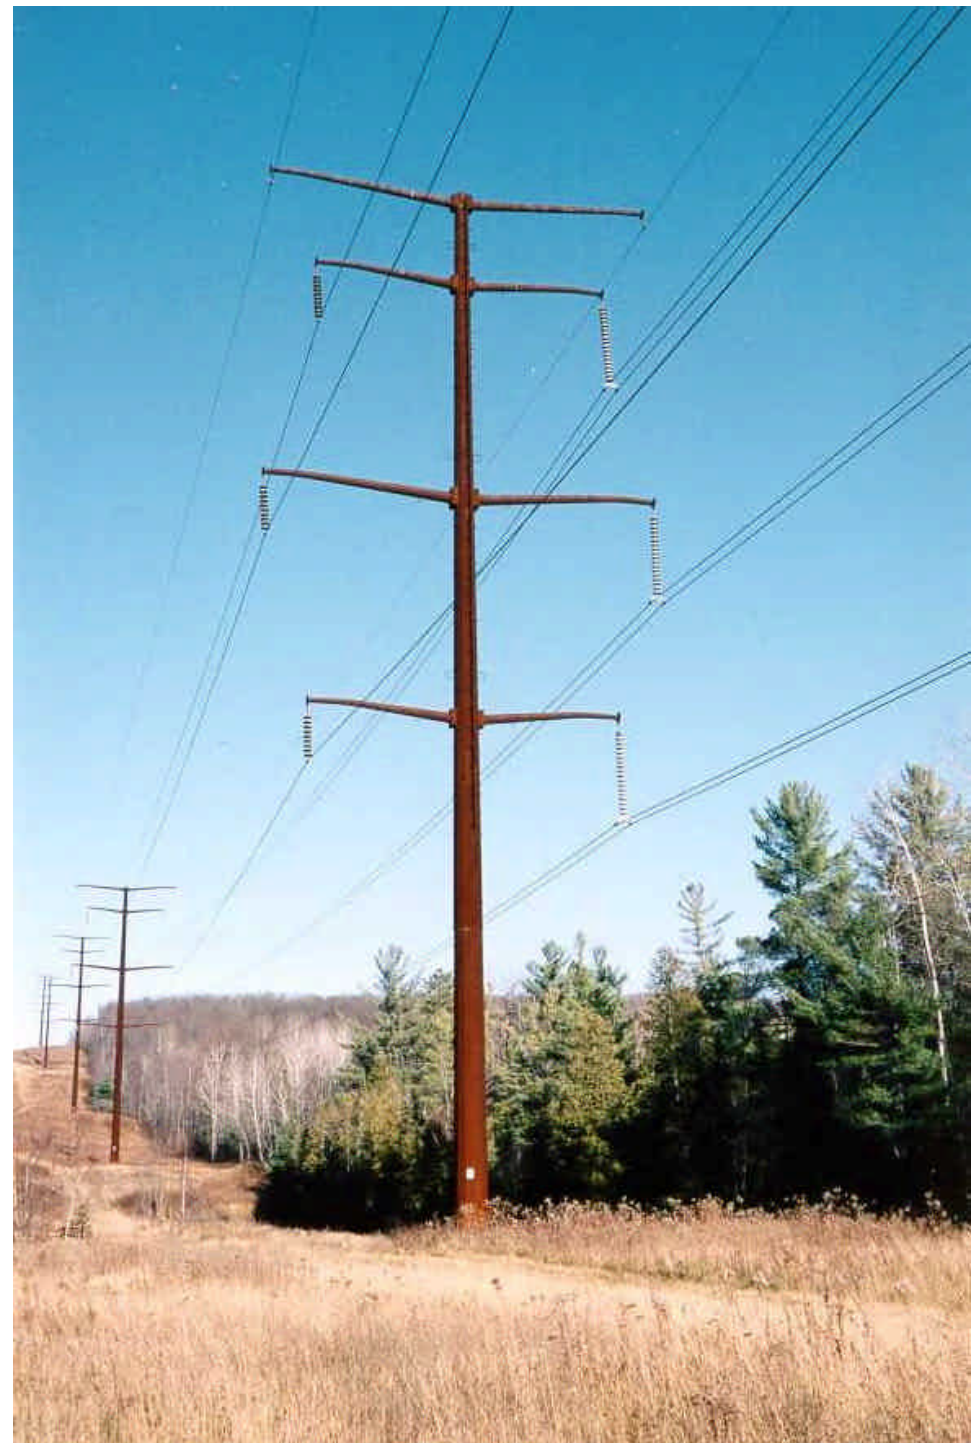


Figure Vol. 2-2 345/138 kV Double Circuit, Single Steel Pole- 345 kV Circuit With Bundled Conductor



Figure Vol. 2-3 345 kV, Single Circuit, Bundled Conductor, Steel Lattice Corner Structure



Figure Vol. 2-4 115 kV, Single Circuit, Single Steel Pole

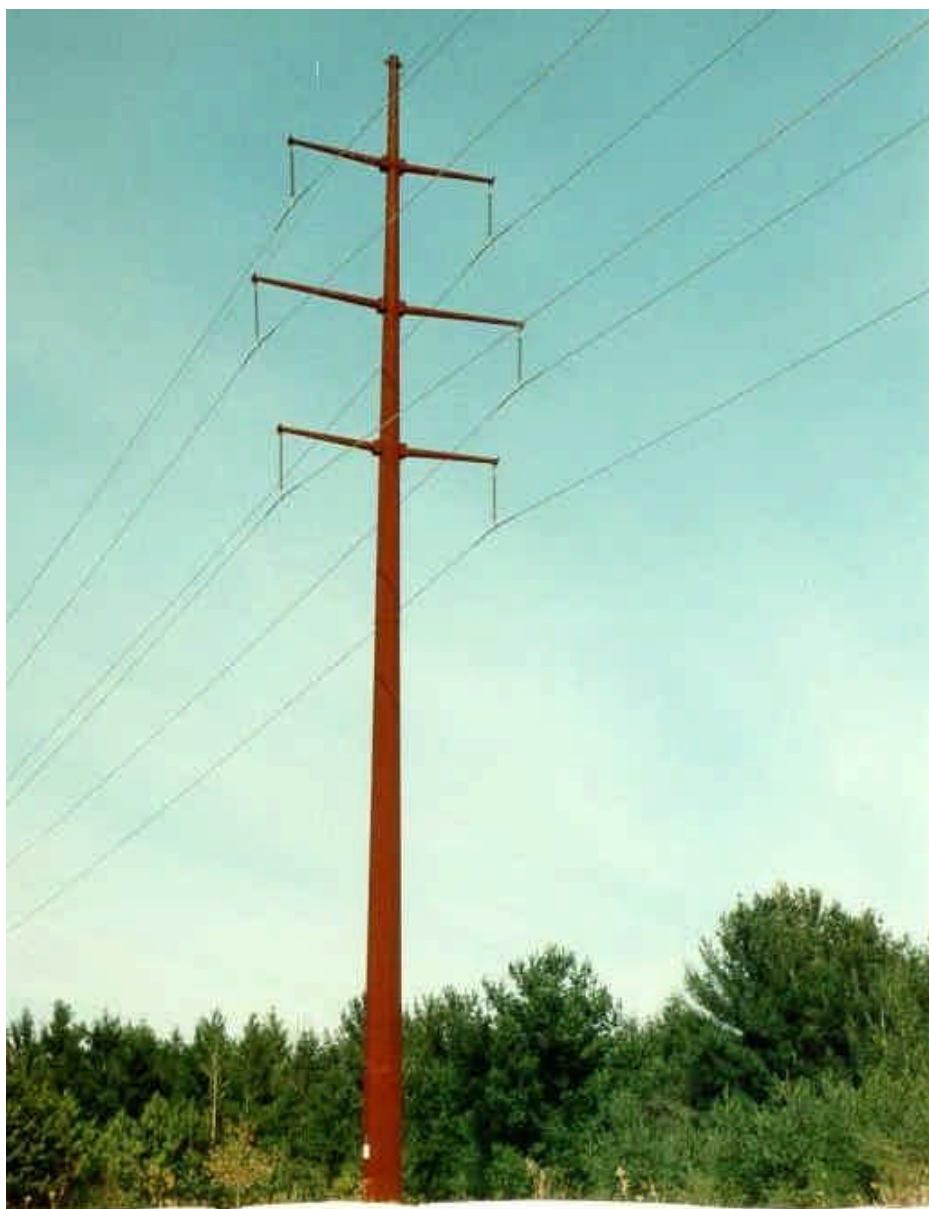


Figure Vol. 2-5 115 kV, Double Circuit, Single Steel Pole



Figure Vol. 2-6 345 kV, Single Circuit, Bundled Conductor, H-Frame Wood Pole: Mixed Agricultural/Forest Setting



Figure Vol. 2-7 Parallel Line Construction - 345 kV, Single Circuit, Bundled Conductor, H-Frame Steel Pole, and 138 kV, Single Circuit, H-Frame Wood Pole: Forest Setting



Figure Vol. 2-8 345 kV, Single Circuit, Bundled Conductor, H-Frame Wood Pole: Agricultural Setting



Figure Vol. 2-9 345 kV, Single Circuit, Wood Pole H-Frame Construction, Bundled Conductors:
Agricultural Setting - Pasture